


1. $\frac{1}{2}$ " HARDWARE - ALUM. BAR: BOLT, NUT, 2 CONICAL & 2 FLAT WASHERS
2. FILLER - ALUM. MESH FILLER, TO BE FILLED IN AROUND BOLTS AND ONE CONTINUOUS $\frac{1}{2}$ LAPPED LAYER AROUND EXPOSED BARS
3. V.F. INSULATING TAPE - 9 HALF LAPPED LAYERS, APPROX. $\frac{3}{16}$ " THICK.
4. FLAME RETARDANT (PVC) JACKETING TAPE - 2 HALF LAPPED LAYERS


SWITCHGEAR TERMINATION TAPING DETAIL

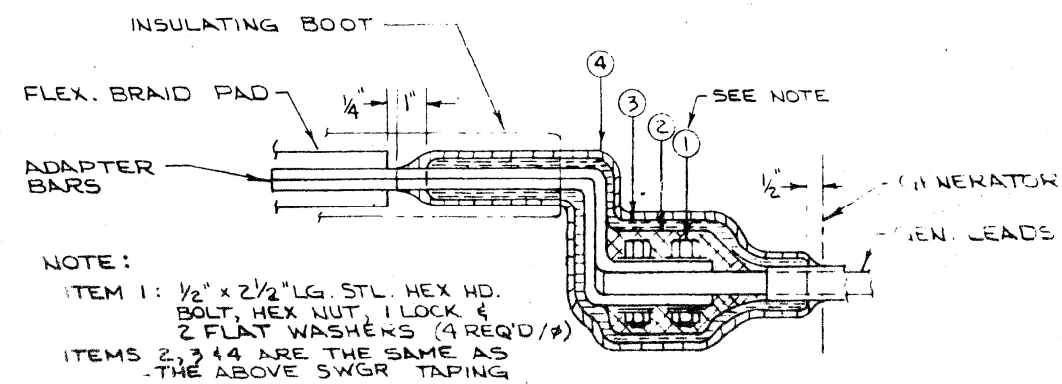

NOTE:
ITEM 1: $\frac{1}{2}$ " x $2\frac{1}{2}$ " LG. STL. HEX HD. BOLT, HEX NUT, 1 LOCK & 2 FLAT WASHERS (4 REQ'D/Ø)
ITEMS 2, 3 & 4 ARE THE SAME AS THE ABOVE SWGR TAPING


ADAPTER BAR TAPING DETAIL (TYP. FOR TOP 3 PHASES OF GEN)

* 6" x 11" OPENING IN BUS DUCT

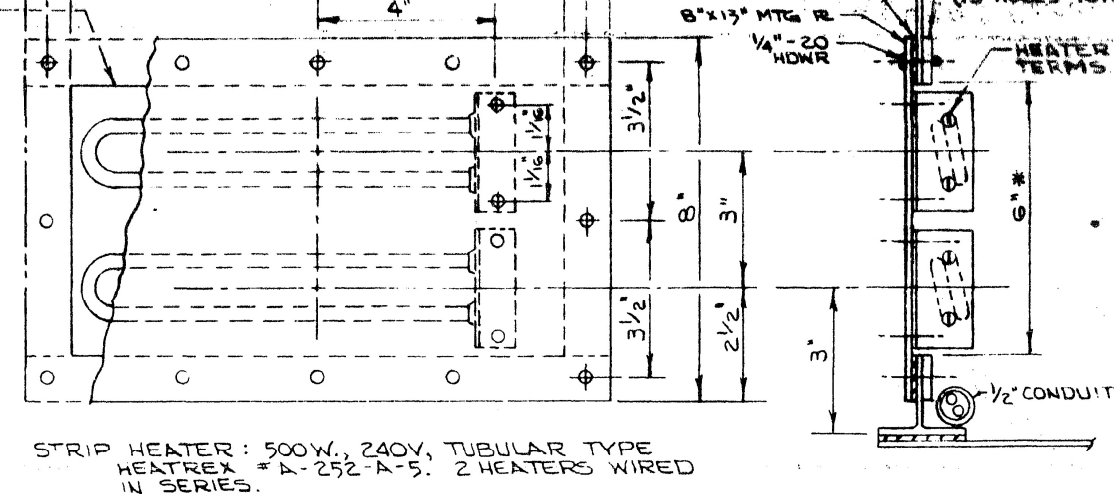

STRIP HEATER: 500W., 240V, TUBULAR TYPE
HEATREX #A-252-A-5. 2 HEATERS WIRED IN SERIES.

HEATER MOUNTING & PLATE ASSEMBLY

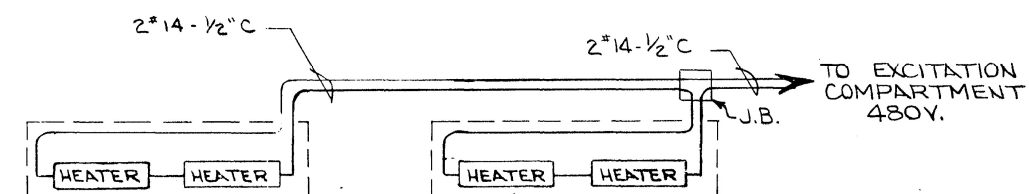

HEATER WIRING DIAGRAM (HTRS. WIRED IN SERIES)

FEB 5 1974

008791

2-4-G-8

C-2465-5